

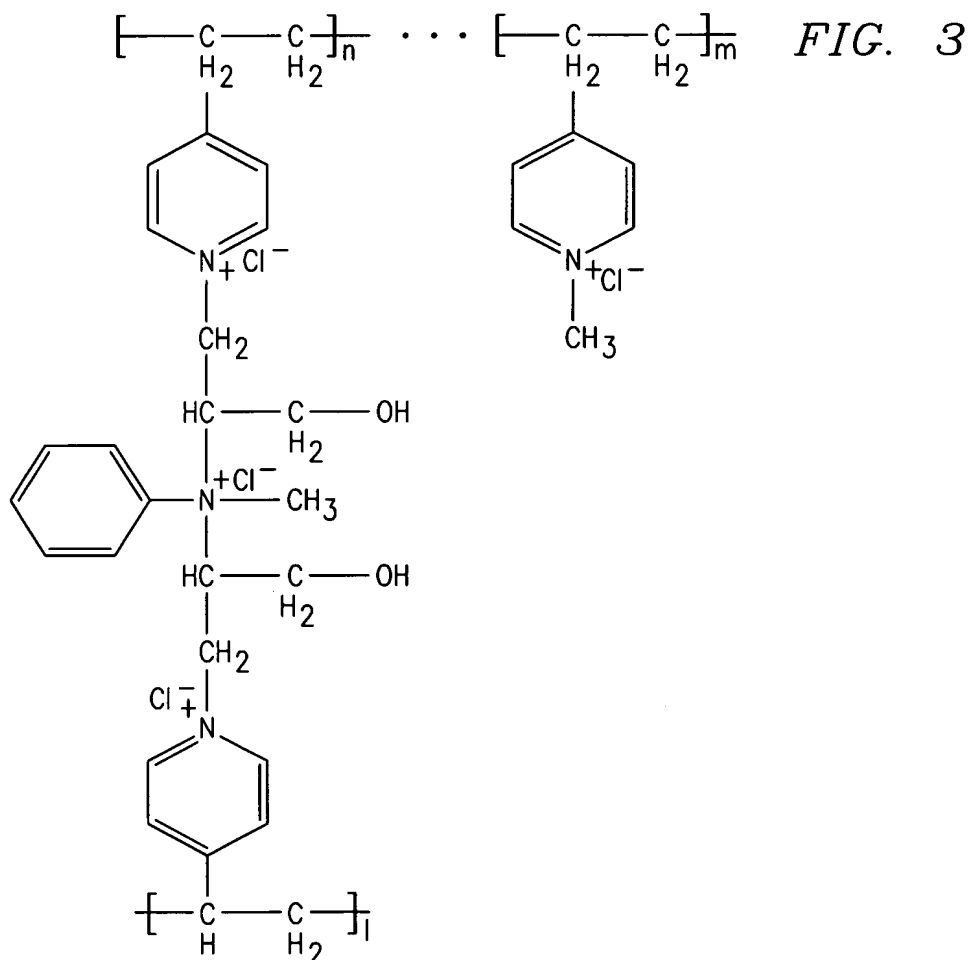


FIG. 1



3/7

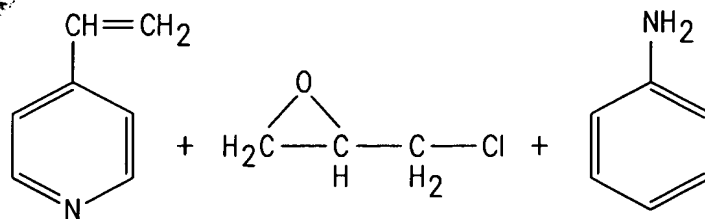

BPO ROOM
 TEMPERATURE

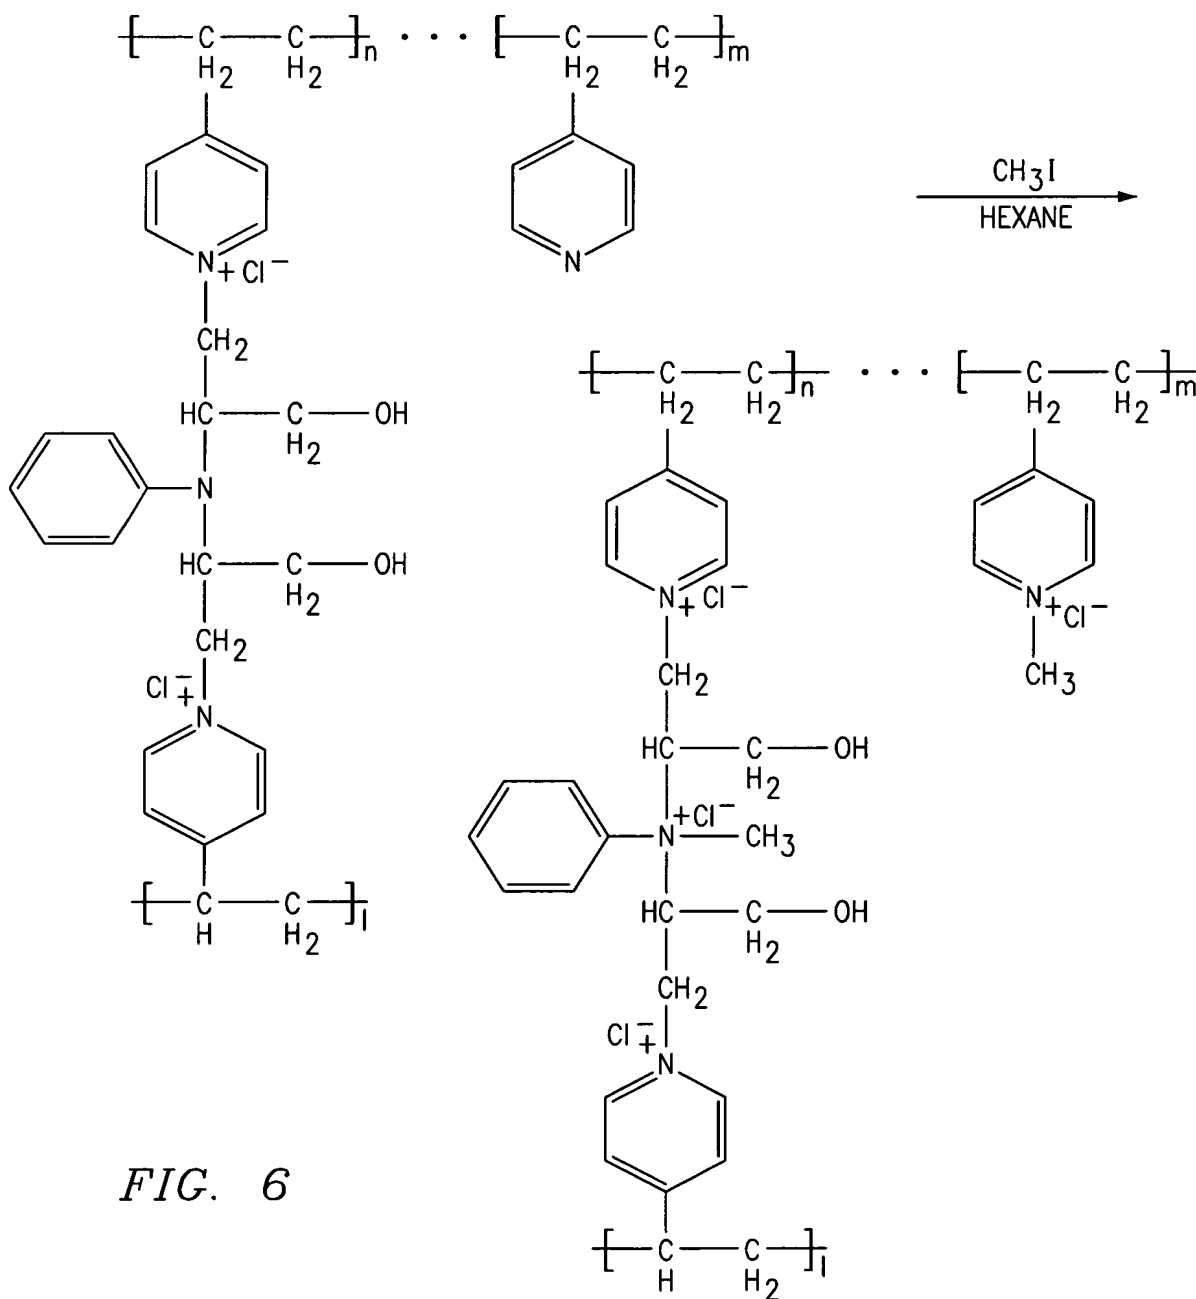


FIG. 6

REPLACEMENT
SHEET

4/7

